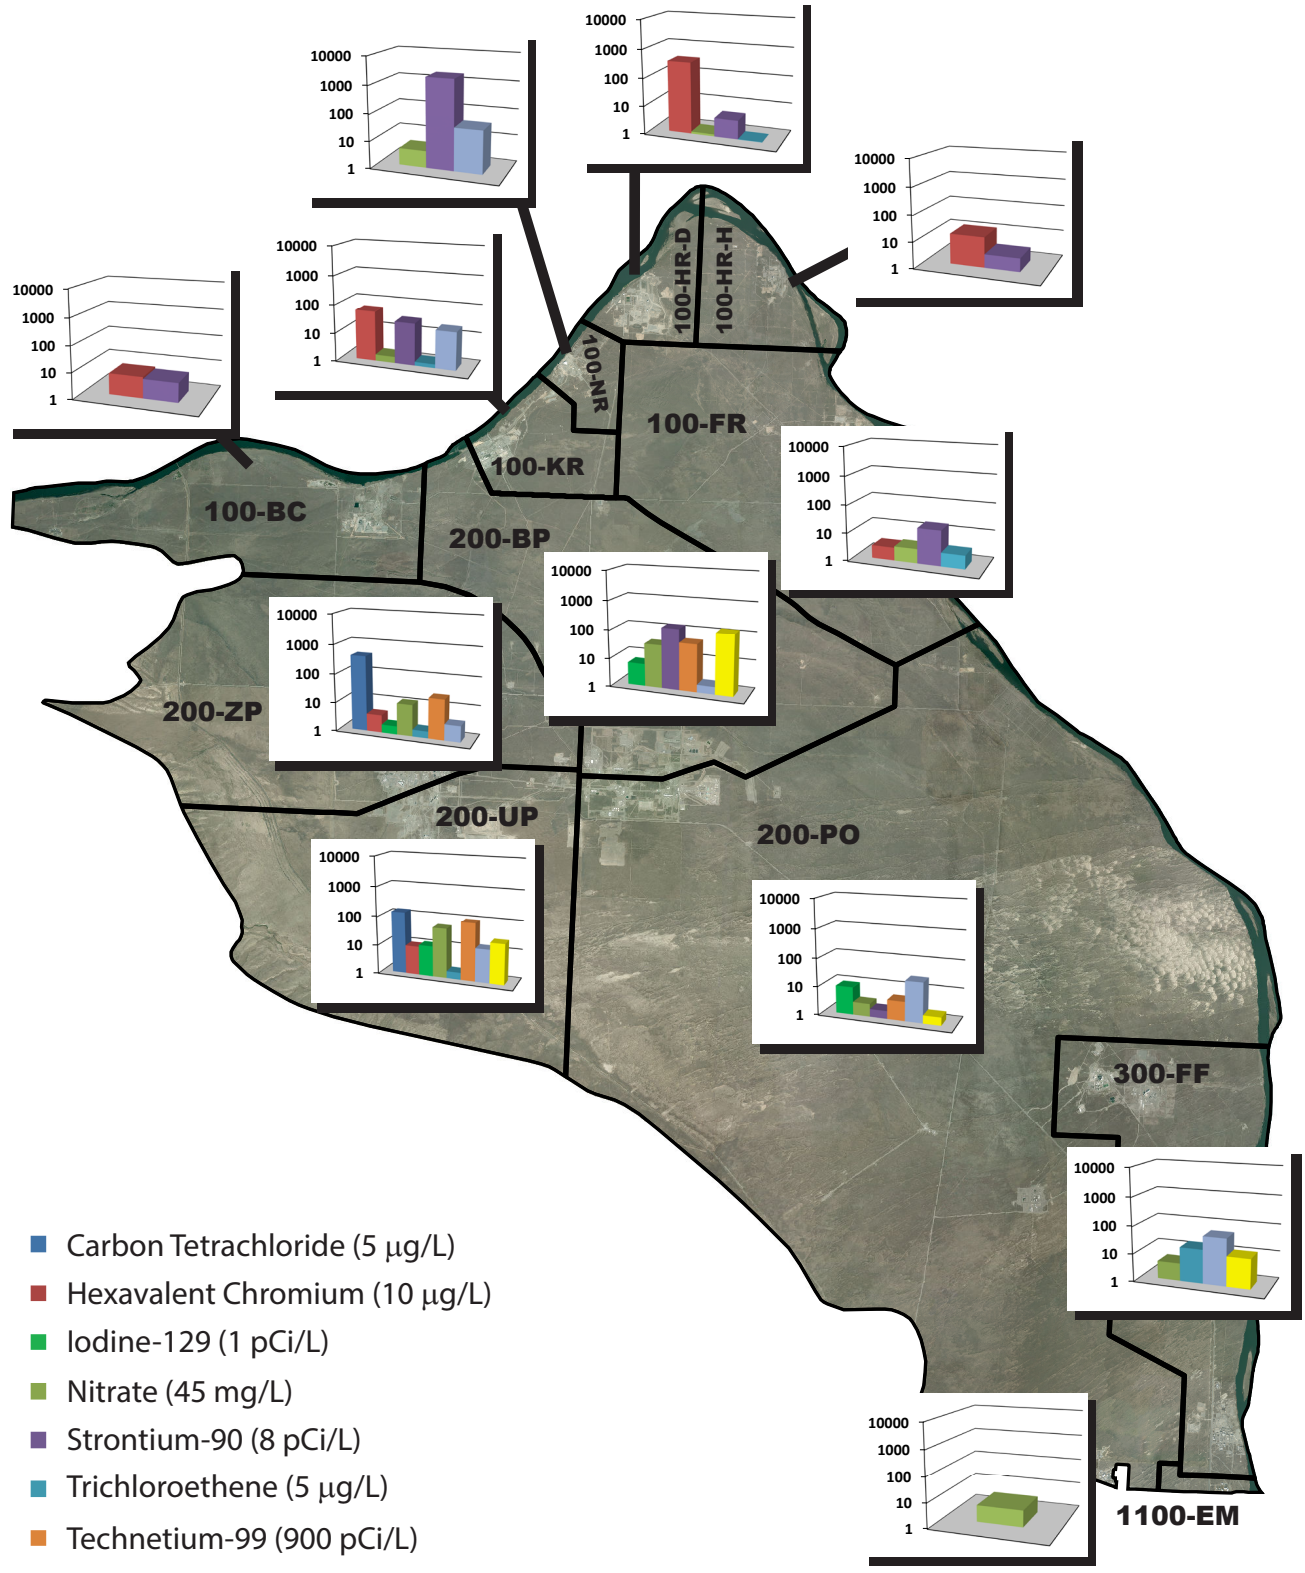

- Carbon Tetrachloride (5 µg/L)
- Hexavalent Chromium (10 µg/L)
- Iodine-129 (1 pCi/L)
- Nitrate (45 mg/L)
- Strontium-90 (8 pCi/L)
- Trichloroethene (5 µg/L)
- Technetium-99 (900 pCi/L)
- Tritium (20,000 pCi/L)
- Uranium (total) (30 µg/L)

Bar height shows contaminant concentrations in multiples of the applicable water quality standard

N

0 5 10 km

0 1 2 3 4 5 mi

CHSGW2014GW03