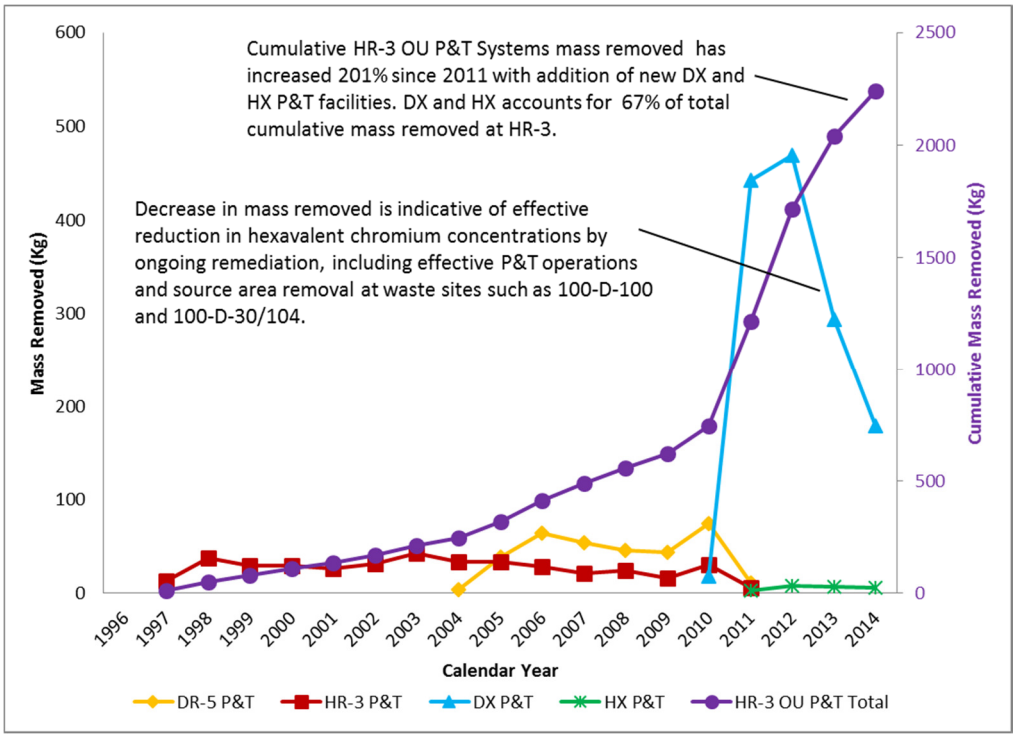


**Figure 1-5. Cr(VI) Mass Removed by the 100-HR-3 OU P&T Systems**