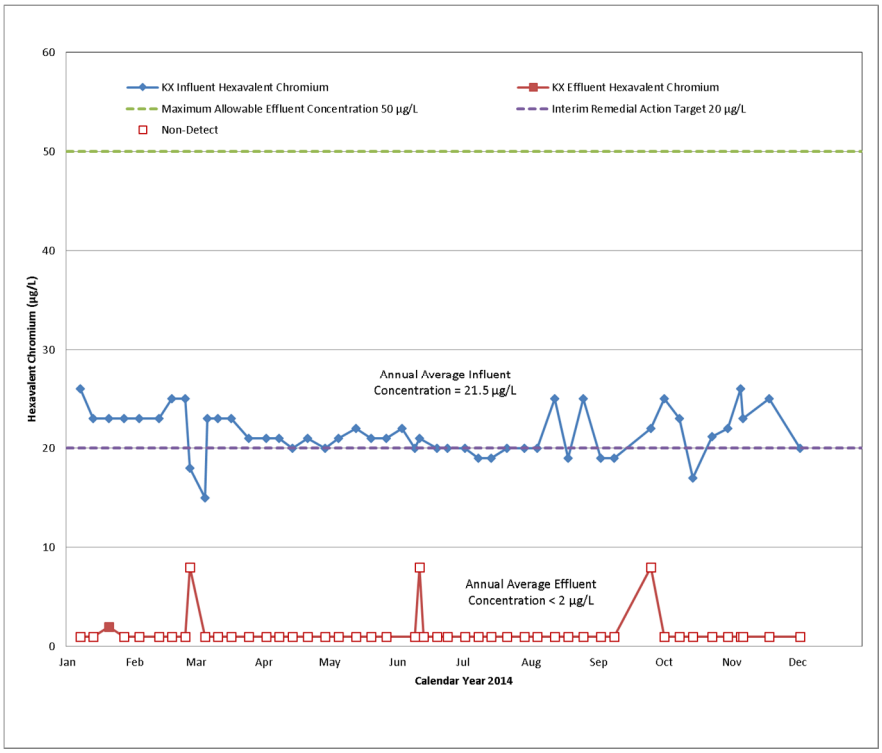

Note: These trends reflect a combination of laboratory and in-plant measurements.

Figure 3-15. KX P&T System Trends of Influent and Effluent Cr(VI) Concentrations, 2014