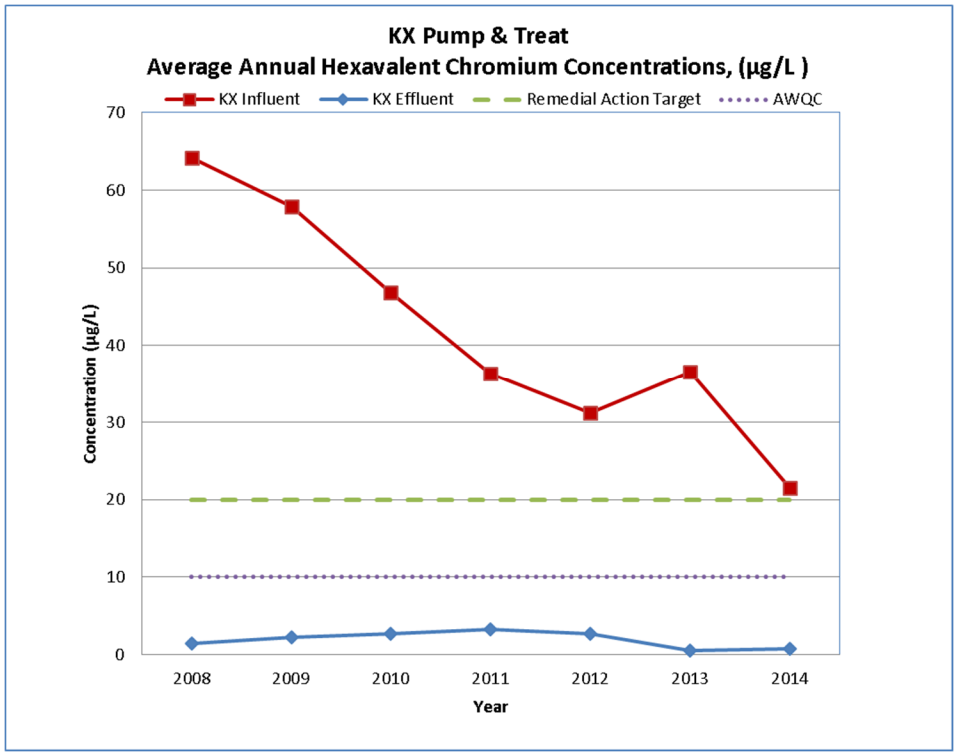

Figure 3-16. KX P&T System Annual Average Influent and Effluent Concentrations